

Public Report

Q-4120-15-RP-009

Talinga Water Treatment Facility Quarterly Discharge Water Quality Report

(1 October to 31 December 2011)

Version:	Rev 1
Released:	16/02/2012
Document Owner:	Manager - Land, Environment and Stakeholder
Review Date:	N/A

*Please see Document control section for more information

Once printed, this is an uncontrolled document
unless issued and stamped Controlled Copy.

Talinga Water Treatment Facility Discharge Water Quality Report (1 October to 31 December 2011)



Contents

1. Summary	3
2. Introduction	3
3. Talinga Water Treatment Facility Scheme Description	5
3.1. Feed Pond	5
3.2. Filtration	6
3.3. Reverse Osmosis	6
3.4. Treated CSG Water Conditioning	6
4. Approvals, Monitoring and Results	6
4.1. Regular External Laboratory Monitoring	6
4.2. TWTF Online Indicator Monitoring	7
4.3. Discharged Treated CSG Water Quality	7
Attachment 1: Summary of Weekly Treated CSG Water Quality Monitoring	9
Data Summary	16
Glossary	17
ABBREVIATIONS & ACRONYMS	18
Document control	19

Controlled Q-4120-15-RP-009
Released on 14/02/2012 - Rev 1

Once printed, this is an uncontrolled document
unless issued and stamped Controlled Copy.

Talinga Water Treatment Facility Discharge Water Quality Report (1 October to 31 December 2011)



1. Summary

Australia Pacific LNG is a joint venture between Origin, ConocoPhillips and Sinopec, to deliver a coal seam gas (CSG) to Liquefied Natural Gas (LNG) project which will deliver gas to domestic and overseas markets.

Australia Pacific LNG is the leading CSG producer in Queensland, supplying more than 40% of the State's domestic gas requirements.

The Talinga Water Treatment Facility (TWTF) has been designed using the best available technology to treat water produced as part of the gas extraction process so that it can be put to a number of beneficial uses such as construction water use and on-site use. Treated CSG water is also discharged to the Condamine River, which is a source of public drinking water.

This report presents a summary of the water quality monitoring results obtained during the fourth quarter of Year 2011 and demonstrates that the TWTF consistently and reliably treats CSG water to a standard which is safe for discharge into a source of public drinking water.

2. Introduction

CSG production relies on the removal of water from the coal seams allowing gas to flow so that it can be readily extracted. The removed water is referred to as CSG water.

CSG water is brackish and alkaline in nature with very few applications for direct use. CSG water can be put to beneficial reuse after treatment through a reverse osmosis process.

The TWTF is one of Australia Pacific LNG's major installations where CSG water is treated. The TWTF uses the best available technologies to treat the water to a high standard.

Once treated, the CSG water is used onsite for Australia Pacific LNG's business activities including for drinking and domestic purposes, operations process water and construction activities. This reduces Australia Pacific LNG's reliance on other water resources.

The treated CSG water is also discharged to the Condamine River where it contributes to the base flows. The Condamine River is an essential resource to local communities and landowners in the region. It is the principal drinking water supply for the Condamine Township (located approximately forty seven kilometres downstream of the TWTF discharge location) as well being used for agricultural irrigation and to support local industries. Protecting its existing quality and condition is therefore vital to ensure its long term sustainable use.

Talinga Water Treatment Facility Discharge Water Quality Report (1 October to 31 December 2011)



Figure 1 - TWTF Discharge Location

To ensure the safety and reliability of the treated CSG water entering the River, Australia Pacific LNG is engaged in a comprehensive ongoing monitoring program of water quality sampling, testing and reporting. This report summarises the results of that monitoring conducted during the fourth quarter (i.e. from 1 October to 31 December) Year 2011.

In presenting this information Australia Pacific LNG honours its commitment to providing transparency and ensuring the community, landowners and other key stakeholders have confidence that the treated CSG water can be safely discharged into a source of drinking water.

This is the third report that publishes information on TWTF's treated CSG water quality. Quarterly reporting will continue throughout the Facility's operational life while it is discharging water into a source of drinking water.

All the reporting is publicly available and can be viewed and downloaded from the Australia Pacific LNG website at www.aplng.com.au. Any enquiries relating to this report should be made to toll free number 1800 526 369.

Alternatively, general enquires can be made by email (contact@aplng.com.au) or mail to Australia Pacific LNG Pty Limited, GPO Box 148, Brisbane, QLD, 4001.

3. Talinga Water Treatment Facility Scheme Description

The TWTF uses a series of water screening, filtration and reverse osmosis processes to remove impurities from the CSG water to ensure its safety and reliability for supply into a drinking water source and beneficial uses. The key treatment processes include:

- Feed pond;
- Filtration;
- Reverse osmosis; and
- Treated CSG water conditioning.

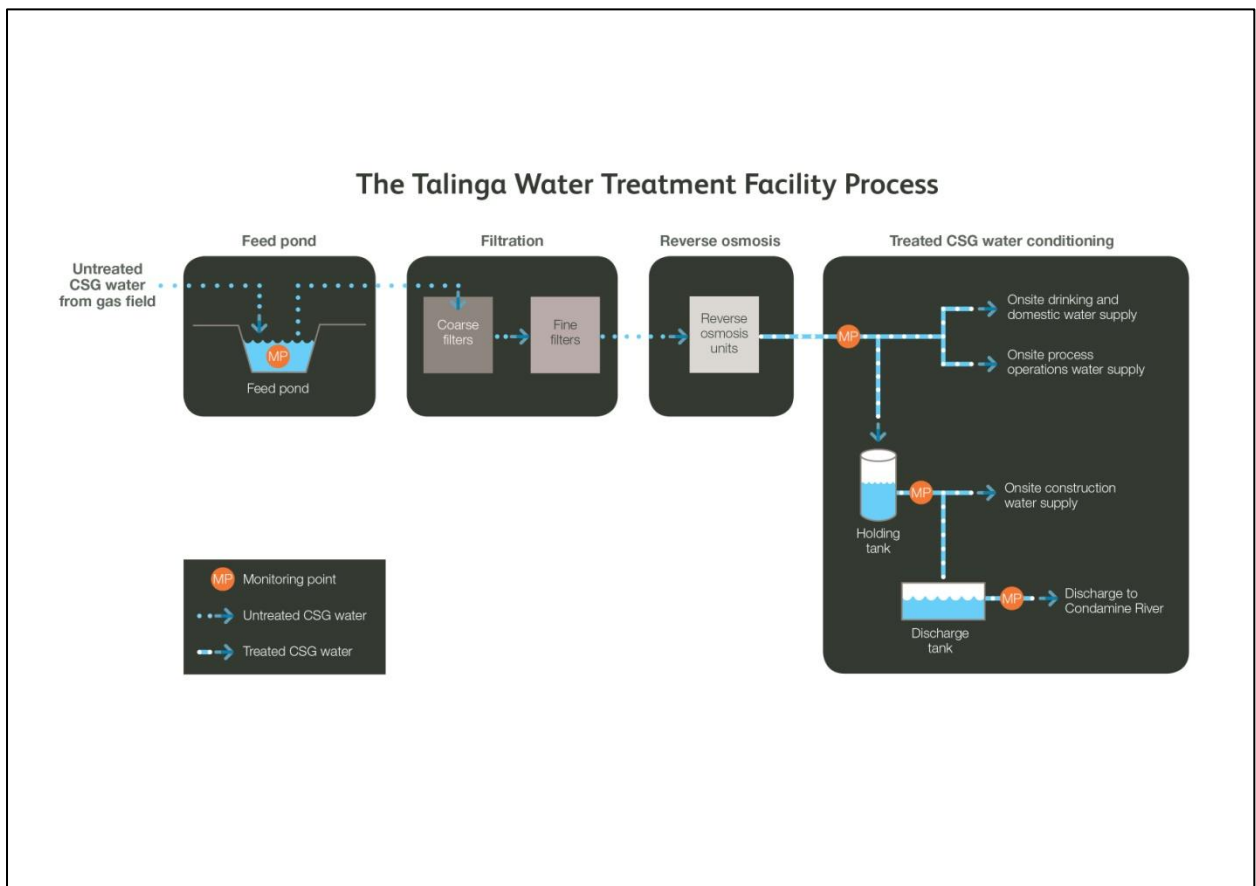


Figure 2 - TWTF Process Schematic

3.1. Feed Pond

Untreated CSG water gathered from the gas field is temporarily stored in a feed pond prior to its treatment by the TWTF. The feed pond holds the CSG water for approximately one to two weeks. This allows the settlement of coarse suspended sediments and provides opportunity for the CSG water to aerate and oxygenate.

Talinga Water Treatment Facility

Discharge Water Quality Report

(1 October to 31 December 2011)



3.2. Filtration

The CSG water is then passed through a coarse filter and then a fine filter to remove any particles or suspended sediments that have not settled within the feed pond. A disinfectant commonly used in domestic water treatment facilities is also added prior to the filtration process to protect the treatment system and membranes used in the following reverse osmosis process.

3.3. Reverse Osmosis

Reverse osmosis involves passing the CSG water through fine membranes at high pressure. This removes most of the dissolved salts and other trace elements.

At this point the water is either transferred to a holding tank, where it is held prior to discharge or piped for use onsite.

3.4. Treated CSG Water Conditioning

Prior to entering the holding tank, the pH of the treated CSG water is adjusted to ensure its suitability for use and the disinfectant added during the filtration process is removed.

Where the treated CSG water is discharged to the Condamine River, calcium and magnesium salts are added. This conditioning is undertaken to ensure a minimum level of these elements are present in the Condamine River to protect the environment. These natural salts are normally present at much higher concentrations in river waters and municipal drinking water supplies.

4. Approvals, Monitoring and Results

In order to discharge to the Condamine River, Australia Pacific LNG gained approval from the Queensland Government's Department of Environment and Resource Management (DERM). The approval was granted under two separate pieces of the Queensland legislation; the Environmental Protection Act (1994) and the Water Supply (Safety and Reliability) Act 2008.

The approved water scheme in operation at Talinga has been prescribed in the Water Supply (Safety and Reliability) Regulation 2011, to be an Interim Recycled Water Management Plan (RWMP). This RWMP outlines an extensive level of water quality monitoring and reporting requirements, designed to ensure the protection of public health.

On the 15 of December 2011, Australia Pacific LNG received approval to amend the interim RWMP to reduce the monitoring frequency of a number of parameters not associated with treated CSG water. The results collected under this amended RWMP will be included in all subsequent Quarterly Water Quality Monitoring Reports (Quarter 1 2012 onwards).

4.1. Regular External Laboratory Monitoring

The CSG water and treated CSG water is regularly sampled and sent to an independent laboratory for testing. The sampling takes place at three monitoring locations:

- at the feed pond;

Controlled Q-4120-15-RP-009
Released on 14/02/2012 - Rev 1

Once printed, this is an uncontrolled document
unless issued and stamped Controlled Copy.

Talinga Water Treatment Facility Discharge Water Quality Report (1 October to 31 December 2011)



- on exit from the holding tank; and
- within the discharge tank prior to the release of the treated CSG water to the Condamine River.

The samples are tested for a comprehensive range of parameters (as shown in Attachment 1 provided at the end of this report).

This water quality monitoring is undertaken using an industry-wide protocol developed by Standards Australia and DERM. Following these standards ensures the water samples are correctly obtained, stored and transported to allow accurate and representative testing in the laboratory.

The water is tested at the Queensland Health Forensic and Scientific Services laboratory. This laboratory is independent to Australia Pacific LNG's operations and is National Association of Testing Authorities (NATA) accredited.

"NATA is the authority that provides independent assurance of technical competence through a proven network of best practice industry experts for customers who require confidence in the delivery of their products and services" – NATA website.

4.2. TWTF Online Indicator Monitoring

It is not possible to continually test all of the parameters that are externally monitored. Water quality indicators, such as pH, turbidity, conductivity, dissolved oxygen and total chlorine are monitored by an online monitoring system to provide a real time overview of the performance and integrity of the treatment process within the facility.

Should any of these indicators vary from their expected ranges, the onsite use and discharge of water to the Condamine River is suspended immediately. No discharge occurs until further investigation, monitoring and corrections are made to ensure the final water quality is safe. This process ensures the quality of water from the TWTF is maintained at the highest level possible.

4.3. Discharged Treated CSG Water Quality

During the fourth quarter of Year 2011 the treated CSG water met all the discharge water quality limits set by DERM prior to its discharge to the Condamine River.

The summary table below presents only the results of parameters that were detected at any point during the fourth quarter of Year 2011. Those parameters that were detected are notably less than the discharge water quality limits, indicating the TWTF complied with its discharge limits during the reporting period.

A complete summary of the monitoring data is provided in Attachment 1 of this report along with a glossary of the parameters analysed.

Talinga Water Treatment Facility Discharge Water Quality Report (1 October to 31 December 2011)



Table 1 - Summary of Maximum Detected Monitoring Results for Treated CSG Water during the Fourth Quarter Year 2011

Parameter		Compliance with Water Quality Limit	Water Quality Limit	Unit	Maximum Detected Concentration for Treated CSG Water
BTEX	All Tested Parameters	100%	Various	µg/L	ND
Chlorinated Hydrocarbons	All Tested Parameters	100%	Various	µg/L	ND
Disinfection By-products	All Tested Parameters	100%	Various	µg/L	ND
Endocrine-Disrupting Chemicals and Hormones	Bisphenol A	100%	200	µg/L	0.52
	Nonylphenol		500	µg/L	ND
Haloacetic Acids	All Tested Parameters	100%	Various	µg/L	ND
Inorganic Compounds	Ammonia as N	100%	500	µg/L	480
	Bromide		7000	µg/L	180
	Fluoride		1500	µg/L	260
	Sulphate		500000	µg/L	9400
Metals	Aluminium	100%	200	µg/L	7
	Barium		700	µg/L	20
	Boron		4000	µg/L	840
	Cadmium		2	µg/L	0.2
	Chromium VI		50	µg/L	0.2
	Iron		300	µg/L	8
	Lead		10	µg/L	0.1
	Manganese		500	µg/L	0.6
	Mercury		1	µg/L	1*
	Nickel		20	µg/L	0.1
	Strontium		4000	µg/L	33
Zinc	3000	µg/L	2		
Nitrosamines	All Tested Parameters	100%	Various	µg/L	ND
Poly Aromatic Hydrocarbons	All Tested Parameters	100%	Various	µg/L	ND
Total Petroleum Hydrocarbons	Total Petroleum Hydrocarbons	100%	200	µg/L	77
Trihalomethanes	Bromodichloromethane	100%	6	µg/L	ND
	Bromoform		100	µg/L	1*
	Dibromochloromethane		100	µg/L	ND
	Chloroform		200	µg/L	7
Radiological Products	Alpha Emitters	100%	0.5	BqL-1	ND
	Beta Emitters		0.5	BqL-1	0.19
	Radon		0.5	BqL-1	0.1

Notes:

ND – Not detected by Laboratory.

* Detected on one occasion during the fourth quarter of Year 2011.

Controlled Q-4120-15-RP-009
Released on 14/02/2012 - Rev 1

Once printed, this is an uncontrolled document unless issued and stamped Controlled Copy.

Attachment 1: Summary of Weekly Treated CSG Water Quality Monitoring

The following section presents a full summary of the weekly monitoring undertaken on the treated CSG water discharged to the Condamine River. The results cover the fourth quarter of Year 2011, from 1 October 2011 to 31 December 2011. The monitoring results have been summarised to show the following:

Parameter – This lists the public health water quality parameters tested at the point of discharge. An explanation of the parameters is provided in the Glossary.

Water Quality Limit – This shows the limits set by DERM.

Unit – This shows the corresponding parameter unit of measurement. It is presented in micro-grams (μg) per litre (L) unless otherwise stated. This unit can also be represented as 'parts per billion' (ppb). Exceptions to this are listed in the reporting tables.

Monitoring Results – For any sample where the laboratory detected the presence of one of the test parameters on one or more occasion, the minimum, maximum and average (mean) concentration is reported. Also shown is the concentration below which 95% of the monitoring results fall. This is represented as the 95th percentile and allows any anomalies and outlying high results to be removed.

Sampling Results – For reasons explained below the results table, there are instances where sampling was not conducted on several of the weeks within the reporting period. For this reason, the total number of reporting weeks is shown, along with the number of samples taken, the number of samples analysed and the number of sample results pending.

Talinga Water Treatment Facility Quarterly Discharge Water Quality Report



(1 October to 30 December 2011)

Parameter	Disinfectant product	Water Quality Limit	Units	Monitoring Results for the Reporting Period				Sampling Results for the Reporting Period					
				Minimum Detected Concentration	Maximum Detected Concentration	Mean Detected Concentration	95 th Percentile	Number of Times Parameter Detected	Total Number Weeks	Total Number of Samples Taken	Total Number of Samples Analysed and Reported	Sample Results Pending	
BTEX	Benzene	1	µg/L			ND		0	13	11	11	0	
	Toluene	800	µg/L			ND		0	13	11	11	0	
	Ethylbenzene	300	µg/L			ND		0	13	11	11	0	
	Xylene Total	600	µg/L			ND		0	13	11	11	0	
Chlorinated Hydrocarbons	1,1-dichloroethene	*	30	µg/L			ND		0	13	11	11	0
	1,2-dichlorobenzene	*	1500	µg/L			ND		0	13	11	11	0
	1,2-dichloroethane	*	3	µg/L			ND		0	13	11	11	0
	1,4-dichlorobenzene	*	40	µg/L			ND		0	13	11	11	0
	Bromochloromethane	*	40	µg/L			ND		0	13	11	11	0
	Chlorobenzene	*	300	µg/L			ND		0	13	11	11	0
	cis-1,2-dichloroethene		60	µg/L			ND		0	13	11	11	0
	trans-1,2-dichloroethene		60	µg/L			ND		0	13	11	11	0
Disinfection By-products	Bromochloroacetonitrile	*	0.7	µg/L			ND		0	13	11	11	0

Controlled Q-4120-15-RP-009
Released on 14/02/2012 - Rev 1

Once printed, this is an uncontrolled document unless issued and stamped Controlled Copy.

Talinga Water Treatment Facility Quarterly Discharge Water Quality Report



(1 October to 30 December 2011)

Parameter	Disinfectant product	Water Quality Limit	Units	Monitoring Results for the Reporting Period				Sampling Results for the Reporting Period					
				Minimum Detected Concentration	Maximum Detected Concentration	Mean Detected Concentration	95 th Percentile	Number of Times Parameter Detected	Total Number Weeks	Total Number of Samples Taken	Total Number of Samples Analysed and Reported	Sample Results Pending	
	Dichloroacetonitrile	*	2	µg/L	ND				0	13	11	11	0
Endocrine-Disrupting Chemicals and Hormones	Nonylphenol		500	µg/L	ND				0	13	11	11	0
	Bisphenol A		200	µg/L	0.054	0.52	0.268	0.491	3	13	11	11	0
Haloacetic Acids	Bromochloroacetic acid	*	0.014	µg/L	ND				0	13	11	11	0
	Chloroacetic acid	*	150	µg/L	ND				0	13	11	11	0
	Dibromoacetic acid	*	0.014	µg/L	ND				0	13	11	11	0
	Dichloroacetic acid	*	100	µg/L	ND				0	13	11	11	0
	Trichloroacetic acid	*	100	µg/L	ND				0	13	11	11	0
Inorganic Compounds	Ammonia as N		500	µg/L	110	480	330	460	11	13	11	11	0
	Bromate		20	µg/L	ND				0	13	11	11	0
	Bromide		7000	µg/L	120	180	140	175	11	13	11	11	0
	Bromine [#]		7000	µg/L	Can't exist in water								
	Chlorate		800	µg/L	ND				0	13	11	11	0
	Chlorine	*	5000	µg/L	ND				0	13	11	11	0

Controlled Q-4120-15-RP-009
Released on 14/02/2012 - Rev 1

Once printed, this is an uncontrolled document unless issued and stamped Controlled Copy.

Talinga Water Treatment Facility Quarterly Discharge Water Quality Report



(1 October to 30 December 2011)

Parameter	Disinfectant product	Water Quality Limit	Units	Monitoring Results for the Reporting Period				Sampling Results for the Reporting Period				
				Minimum Detected Concentration	Maximum Detected Concentration	Mean Detected Concentration	95 th Percentile	Number of Times Parameter Detected	Total Number Weeks	Total Number of Samples Taken	Total Number of Samples Analysed and Reported	Sample Results Pending
Chlorite	*	300	µg/L	ND				0	13	11	11	0
Cyanide Total		80	µg/L	ND				0	13	11	11	0
Fluoride		1500	µg/L	150	260	200	255	11	13	11	11	0
Iodide		100	µg/L	ND				0	13	11	11	0
Iodine [^]		60	µg/L	Can't exist in water								
Monochloramine	*	3000	µg/L	ND				0	13	11	11	0
Nitrate (as NO ₃ -)		50000	µg/L	ND				0	13	11	11	0
Nitrite (as N)		3000	µg/L	ND				0	13	11	11	0
Sulphate		500000	µg/L	1900	9400	7080	9265	10	13	11	11	0
Metals												
Aluminium		200	µg/L	3	7	4.6	6.6	5	13	11	11	0
Antimony		3	µg/L	ND				0	13	11	11	0
Arsenic		7	µg/L	ND				0	13	11	11	0
Barium		700	µg/L	0.8	20	8	18.5	11	13	11	11	0
Boron		4000	µg/L	660	840	750	835	11	13	11	11	0
Cadmium		2	µg/L	0.1	0.2	0.15	0.195	2	13	11	11	0
Chromium (hexavalent)		50	µg/L	0.1	0.2	0.175	0.2	4	13	11	11	0

Controlled Q-4120-15-RP-009
Released on 14/02/2012 - Rev 1

Once printed, this is an uncontrolled document unless issued and stamped Controlled Copy.

Talinga Water Treatment Facility Quarterly Discharge Water Quality Report



(1 October to 30 December 2011)

Parameter	Disinfectant product	Water Quality Limit	Units	Monitoring Results for the Reporting Period				Sampling Results for the Reporting Period				
				Minimum Detected Concentration	Maximum Detected Concentration	Mean Detected Concentration	95 th Percentile	Number of Times Parameter Detected	Total Number Weeks	Total Number of Samples Taken	Total Number of Samples Analysed and Reported	Sample Results Pending
Copper		2000	µg/L	ND				0	13	11	11	0
Iron		300	µg/L	6	8	7	7.9	2	13	11	11	0
Lead		10	µg/L	0.1	0.1	0.1	0.1	3	13	11	11	0
Manganese		500	µg/L	0.2	0.6	0.31	0.53	8	13	11	11	0
Mercury		1	µg/L	1	1	1	1	1	13	11	11	0
Molybdenum		50	µg/L	ND				0	13	11	11	0
Nickel		20	µg/L	0.1	0.1	0.1	0.1	2	13	11	11	0
Selenium		10	µg/L	ND				0	13	11	11	0
Silver		100	µg/L	ND				0	13	11	11	0
Strontium		4000	µg/L	1.8	33	14	30	11	13	11	11	0
Thallium		Detection limit	µg/L	ND				0	13	11	11	0
Titanium		Detection limit	µg/L	ND				0	13	11	11	0
Uranium		20	µg/L	ND				0	13	11	11	0
Vanadium		50	µg/L	ND				0	13	11	11	0
Zinc		3000	µg/L	1	2	1.5	2	6	13	11	11	0

Controlled Q-4120-15-RP-009
Released on 14/02/2012 - Rev 1

Once printed, this is an uncontrolled document unless issued and stamped Controlled Copy.

Talinga Water Treatment Facility Quarterly Discharge Water Quality Report



(1 October to 30 December 2011)

Parameter		Disinfectant product	Water Quality Limit	Units	Monitoring Results for the Reporting Period				Sampling Results for the Reporting Period				
					Minimum Detected Concentration	Maximum Detected Concentration	Mean Detected Concentration	95 th Percentile	Number of Times Parameter Detected	Total Number Weeks	Total Number of Samples Taken	Total Number of Samples Analysed and Reported	Sample Results Pending
Nitrosamines	N-Nitrosodiethylamine (NDEA)	*	0.01	µg/L	ND				0	13	11	11	0
	N-Nitrosodimethylamine (NDMA)	*	0.01	µg/L	ND				0	13	11	11	0
Poly Aromatic Hydrocarbons	2,4,5-Trichlorophenol		350	µg/L	ND				0	13	11	11	0
	2,4,6-Trichlorophenol		20	µg/L	ND				0	13	11	11	0
	2,4-Dichlorophenol	*	200	µg/L	ND				0	13	11	11	0
	2-Chlorophenol	*	300	µg/L	ND				0	13	11	11	0
	4-Methylphenol		600	µg/L	ND				0	13	11	11	0
	4-nitrophenol		30	µg/L	ND				0	13	11	11	0
	Acenaphthene		20	µg/L	ND				0	13	11	10 ¹	0
	Acenaphthylene		0.014	µg/L	ND				0	13	11	10 ¹	0
	Anthracene		150	µg/L	ND				0	13	11	11	0
	Benzo(a) pyrene		0.01	µg/L	ND				0	13	11	11	0
	Phenanthrene		150	µg/L	ND				0	13	11	11	0

Controlled Q-4120-15-RP-009
Released on 14/02/2012 - Rev 1

Once printed, this is an uncontrolled document unless issued and stamped Controlled Copy.

Talinga Water Treatment Facility Quarterly Discharge Water Quality Report



(1 October to 30 December 2011)

Parameter	Disinfectant product	Water Quality Limit	Units	Monitoring Results for the Reporting Period				Sampling Results for the Reporting Period				
				Minimum Detected Concentration	Maximum Detected Concentration	Mean Detected Concentration	95 th Percentile	Number of Times Parameter Detected	Total Number Weeks	Total Number of Samples Taken	Total Number of Samples Analysed and Reported	Sample Results Pending
		150	µg/L	ND				0	13	11	11	0
		150	µg/L	ND				0	13	11	11	0
Total Petroleum Hydrocarbons	Total Petroleum Hydrocarbons	200	µg/L	57	77	64	75.1	3	13	11	11	0
Trihalomethanes	Bromodichloromethane	*	6	ND				0	13	11	11	0
	Bromoform	*	100	1	1	1	1	1	13	11	11	0
	Dibromochloromethane		100	ND				0	13	11	11	0
	Chloroform	*	200	3	7	5	6.5	11	13	11	11	0
Radiological Products	Alpha Emitters		0.5	ND				0	13	11	11	0
	Beta Emitters		0.5	0.14	0.19	0.165	0.188	2	13	11	11	0
	Radon		0.5	0.1	0.1	0.1	0.1	2	13	11	9 ²	0

Legend:

ND – Not detected by the Laboratory

Notes:

Note 1: One week of results for Acenaphthene and Acenaphthylene could not be reliably quantified by QHFSS and was subsequently not provided by the laboratory. This was potential due to either interfering compounds or a low surrogate recovery result.

Note 2: Results for Radon were unavailable on the 02 of November 2011 due to a lab error and 28 of December 2011 due to the holding times being exceeded due to the Christmas break.

Controlled Q-4120-15-RP-009
Released on 14/02/2012 - Rev 1

Once printed, this is an uncontrolled document unless issued and stamped Controlled Copy.

Talinga Water Treatment Facility Discharge Water Quality Report



(1 July to 30 September 2011)

Data Summary

Whilst every effort has been made to assess and analyse all the parameters over the fourth quarter of Year 2011 there were certain instances (which are discussed below) where this was not possible or not necessary.

No discharge

During the fourth quarter of 2011 there were 2 weeks (09 of November 2011 and , 16 of November 2011) when the plant was not operational at the times when samplers were present as it was undergoing maintenance. Therefore, no water was discharged to the Condamine River.

Flooding

During the fourth quarter of 2011 there was two occasions when access to the discharge monitoring location was not possible due to flooding. On this occasion, sampling results from monitoring undertaken at the holding tank and have been reported in the summary tables provided above.

Missing Parameters

The following water quality parameters not monitored for during the fourth quarter of Year 2011 being:

- Hydrazine and Chlorine Dioxide. No results for reporting period. These compounds break down exceptionally quickly therefore cannot be tested under laboratory conditions. If present within the treated CSG water they would also break down rapidly therefore removing any public health risk.
- Iodine and Bromine. No results for reporting period. Iodine and Bromine do not exist in this form in water but do exist as Iodide and Bromide respectively. In the previous Talinga Water Treatment Facility Discharge Water Quality Report (Q-4411-15-RP-001), Iodine and Bromine results were reported, however, it has since been confirmed by the laboratory that these were incorrectly reported and should have been Iodide and Bromide.
- 4-Chlorophenol. No results for reporting period. This compound is not expected to be generated by the TWTF process. The laboratory was requested by Australia Pacific LNG to undertake this analysis, however, it has been identified that the laboratory did not have an appropriate test method. It is anticipated that this parameter will not form part of the ongoing monitoring program.
- 2, 2 Dichloropropionic Acid (DPA) and Acrylamide (2-propenamamide). No results for reporting period. These compounds are not expected to be generated by the TWTF process. Due to miscommunication with the laboratory the analysis was not undertaken. It is anticipated that this parameter will not form part of the ongoing monitoring program.
- Acenaphthene and Acenaphthylene . Results for Acenaphthene and Acenaphthylene could not be reliably quantified by QHFSS on the 19 of October 2011.

Controlled Q-4120-15-RP-009
Released on 14/02/2012 - Rev 1

Once printed, this is an uncontrolled document
unless issued and stamped Controlled Copy.

Talinga Water Treatment Facility Discharge Water Quality Report



(1 July to 30 September 2011)

- Radon: Results for Radon were unavailable on the 02 of November 2011 due to a lab error and 28 of December 2011 due to the holding times being exceeded due to the Christmas break.

Glossary

The parameters required to be monitored by Australia Pacific LNG by DERM are in many cases not found within treated CSG water or the water treatment industry. The monitoring undertaken by Australia Pacific LNG is designed to provide a conservative level of assurance to ensure the protection of public health. A brief definition of the sets of parameters contained within the reported information is provided below.

BTEX – BTEX is an acronym representing benzene, toluene, ethylbenzene, and xylenes. These are compounds that may be associated with oil and gas production. BTEX are generally not associated with CSG production, although may occur at trace levels.

Chlorinated Hydrocarbons – These are organic compounds that may be generated as a by-product of chlorination. They are considered commonplace in everyday life and can occur naturally, in some animals or as the by-product of fires.

Disinfection By-products – Disinfectants are routinely used in water treatment facilities to remove biological contaminants (predominantly algae and bacteria) that may decrease the efficiency and integrity of the water treatment process. Disinfectants may react with naturally-occurring matter to form by-products.

Endocrine-Disrupting Chemicals (EDCs) and Hormones – The two relevant compounds include Bisphenol A (BPA) and Nonylphenol. BPA is often associated with moulded plastic. Nonylphenol can be found in commercial detergents.

Haloacetic acids – These can be a by-product of drinking water chlorination or chloramination (that is the use of disinfectant). These are routine methods used for disinfection of drinking water to remove bacteria and other microbiological organisms.

Inorganic Compounds – These compounds are non-carbon based elements. In terms of drinking water chemistry they include compounds such as ammonia, bromide and fluoride.

Metals – These naturally occur in drinking water due to the water passing through metal-enriched rock. Certain metals are essential for life. Also specific metal-based salts, namely calcium and magnesium, are added to the treated CSG water prior to discharge to the River to ensure a minimum level is present to protect the environment.

Nitrosamines – These compounds are commonly associated with water treatment facilities that utilise chloramines for disinfection and include N-Nitrosodiethylamine (NDEA) and N-Nitrosodimethylamine (NDMA).

Polycyclic Aromatic Hydrocarbons (PAH) – PAH occur in oil, coal and tar products and may be associated with water extracted from coal seams at low levels. They are naturally occurring and do not readily dissolve in water.

Controlled Q-4120-15-RP-009
Released on 14/02/2012 - Rev 1

Once printed, this is an uncontrolled document
unless issued and stamped Controlled Copy.

Page 17 of 20

Talinga Water Treatment Facility Discharge Water Quality Report



(1 July to 30 September 2011)

Total Petroleum Hydrocarbons (TPH) – TPH is the term given to a mixture of hydrocarbons (compounds that contain hydrogen and carbon) that occur naturally and in oil, coal and tar products. TPH may be associated with CSG water at low levels.

Trihalomethanes – These include the branch of chemical compounds that may be formed as a by-product of disinfecting drinking water with chlorine or monochloramine.

Radiological Products – These occur naturally in drinking water at extremely low concentrations *via* contact with certain rocks such as granite.

ABBREVIATIONS & ACRONYMS

Term/Abbreviation/Acronym	Definition
µg	Micrograms (1×10^{-3} grams)
Australia Pacific LNG	Australia Pacific LNG Pty Limited
Bq	Becquerel(s)
CSG	Coal seam gas
DERM	Department of Environment and Resource Management
L	Litre(s)
LNG	Liquefied natural gas
NATA	National Association of Testing Authorities
ND	Not detected
QLD	Queensland
the Act	<i>Water Supply (Safety and Reliability) Act 2008</i>
TWTF	Talinga Water Treatment Facility

This Report has been produced in accordance with the Queensland Government's *Public Reporting Guideline for Recycled Water Schemes* (DERM, 2011) and the *Water Supply (Safety and Reliability) Act 2008* (the Act). Australia Pacific LNG currently operates under an approved interim recycled water management plan in accordance with the Act.

Controlled Q-4120-15-RP-009
Released on 14/02/2012 - Rev 1

Once printed, this is an uncontrolled document
unless issued and stamped Controlled Copy.

Talinga Water Treatment Facility Discharge Water Quality Report



(1 July to 30 September 2011)

Document control

Author (To whom any changes are to be recommended)			
Position		Incumbent	
Senior Environmental Advisor- Technical		Matt Kernke	
Stakeholders and other contributors			
Position		Incumbent	
Reviewed by			
Position		Incumbent	Review date
Manager Environmental Approvals and Strategy		Rob Uilly	
Communications Manager, Exploration & Production and Australia Pacific LNG		Karen Cottier	
Approved by			
Position		Incumbent	Approval date
Manager – Land, Environment and Stakeholder		Rebecca Pickering	
History			
Date	Author	Version	Nature of change
16/02/2012	MAK	1	Revised issue
Related documents			
Title		Review Date	
Review Requirements			
Not required.			
Controlled document location			
Key Document (Refer definitions in Key Documents Directive to determine)			

Controlled Q-4120-15-RP-009
Released on 14/02/2012 - Rev 1

Once printed, this is an uncontrolled document
unless issued and stamped Controlled Copy.

Talinga Water Treatment Facility Discharge Water Quality Report

(1 July to 30 September 2011)



This document is not an Australia Pacific LNG Key Document

Controlled **Q-4120-15-RP-009**
Released on 14/02/2012 - Rev 1

Once printed, this is an uncontrolled document
unless issued and stamped Controlled Copy.